


NOTES:

1. CABLE DUCT AND CONDUIT IS TO EXTEND A MINIMUM 2" ABOVE GROUND LEVEL IN THE CABLE SLOT.
2. IN GROUNDING THE CONCENTRIC NEUTRAL SLACK IS TO BE ALLOWED FOR OPERATING THE ELBOW CONNECTOR.
3. OMIT THE SECONDARY NEUTRAL GROUND CONNECTION IF A GROUND STRAP IS PRESENT.

SECONDARY SERVICE PIPE LOCATION IN PAD MOUNT

2nd LOCATION IF MULTI SERVICES

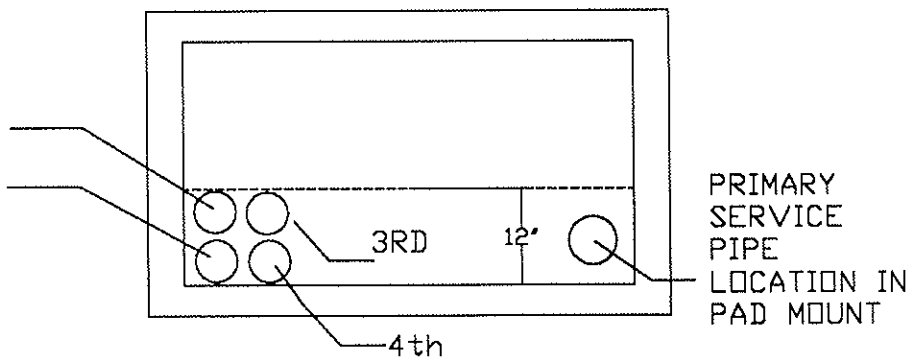

MLEC

CONNECTIONS ON A GROUNDED-FRONT
PAD-MOUNTED TRANSFORMER

4/12/02

UG6