

MLEC SINGLE PHASE URD PRIMARY



NOTE: Three Phase URD Primary is handled on an individual basis.

MLEC will furnish and install:



1. 3" dia. schedule 80 electrical grade PVC & all related hardware attached to primary pole

Items 1 through 7, below, shall be furnished and installed by member

1. Fiberglass pad to be picked up at local office and installed per instructions to the right
2. 1/4" braided nylon rope inside raceway/conduit
3. 90° elbow, 3" dia. schedule 40 electrical grade PVC, minimum 36" elbow radius
4. 3" dia. schedule 40 electrical grade PVC; schedule 80 PVC to be used under roads or driveways
5. Member to backfill ditch after inspection by MLEC -- 24 hour notice is required
6. Stone or Creek gravel 6" below each elbow
7. 6 holes, 1/4" dia. located along bottom of each elbow

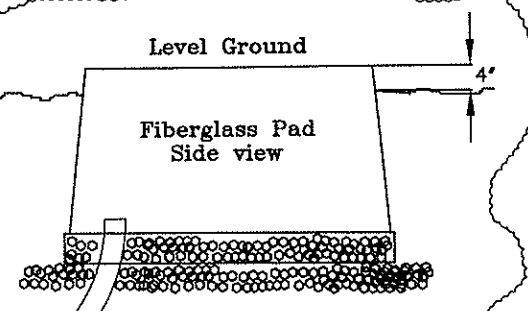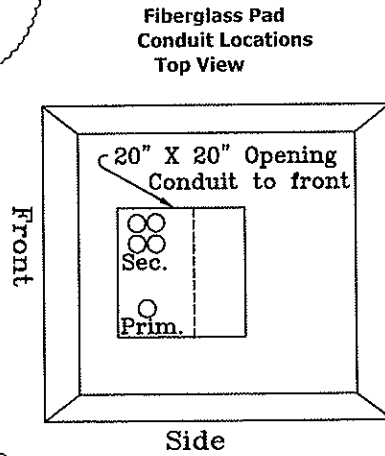

Place pad on compact gravel and place 4" of gravel inside pad.

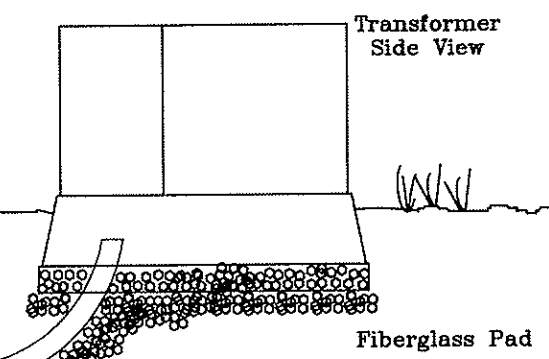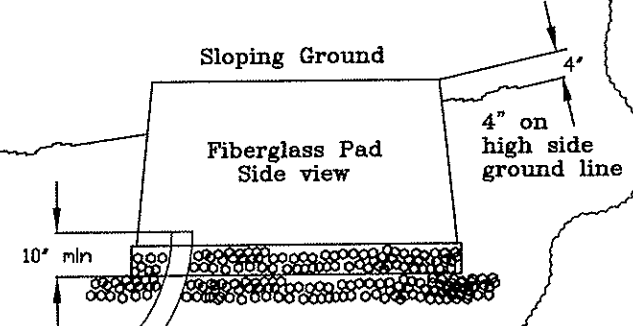

36" Minimum